




T7203-12-8-8FF15 LOCATION DIAGRAM / MAINTENANCE BULLETIN

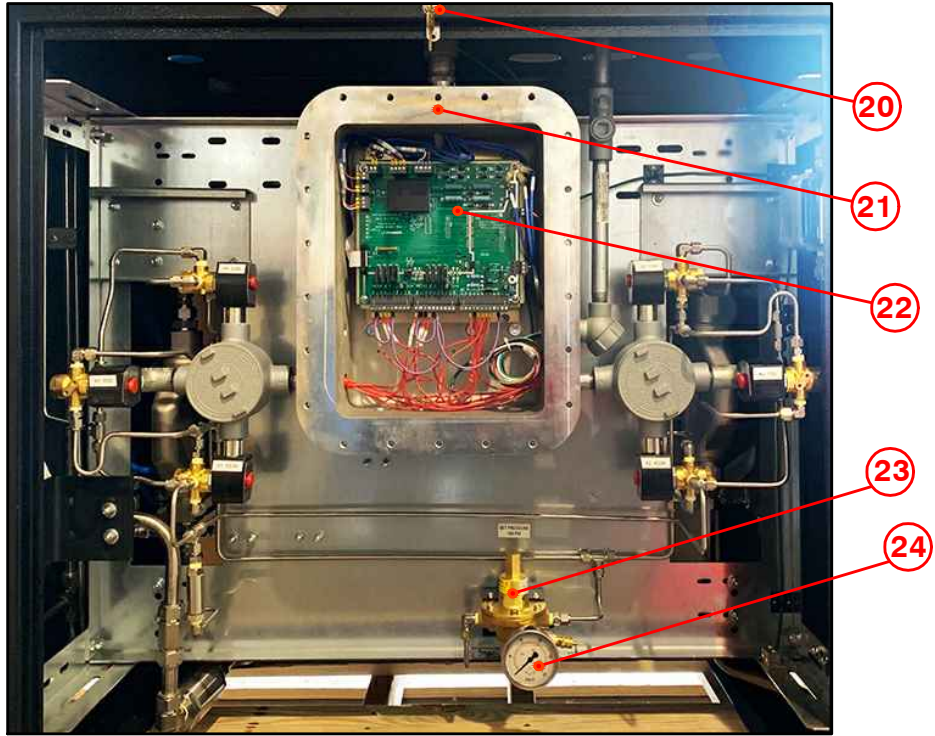

LOWER ENCLOSURE FRONT

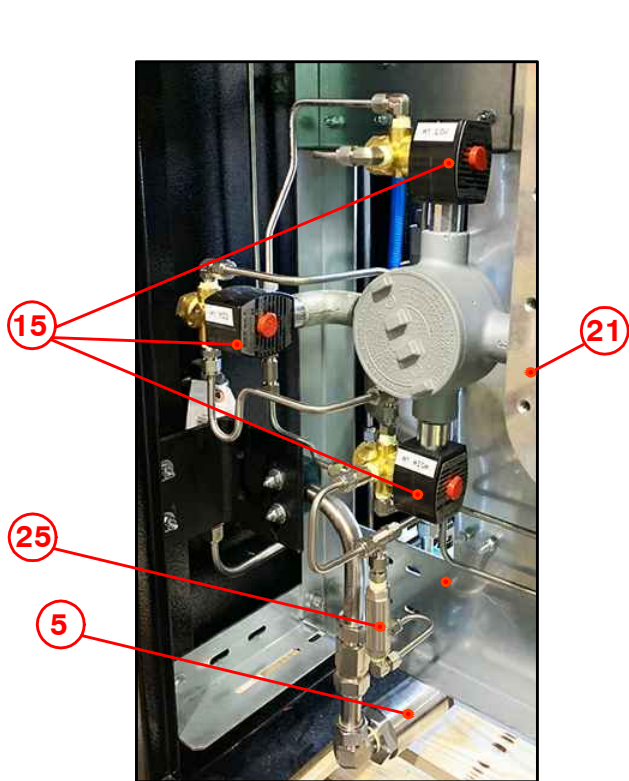


LOWER ENCLOSURE FRONT LEFT

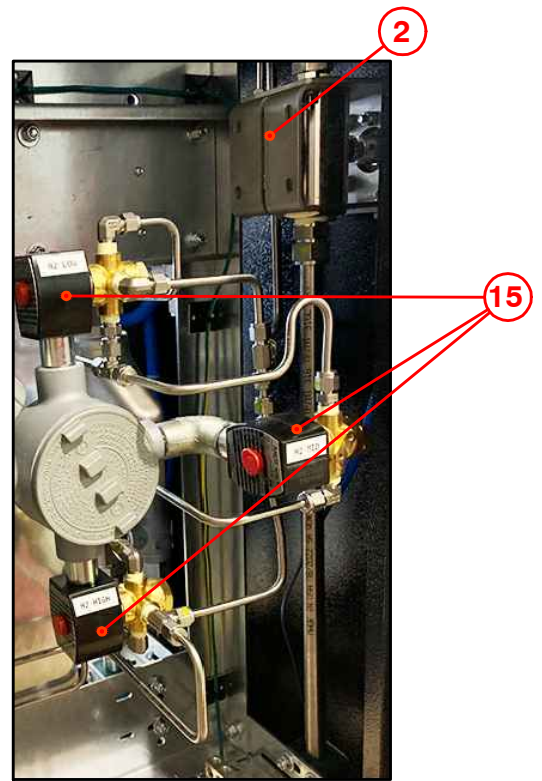


LOWER ENCLOSURE FRONT RIGHT


T7203-12-8-8FF15 LOCATION DIAGRAM / MAINTENANCE BULLETIN

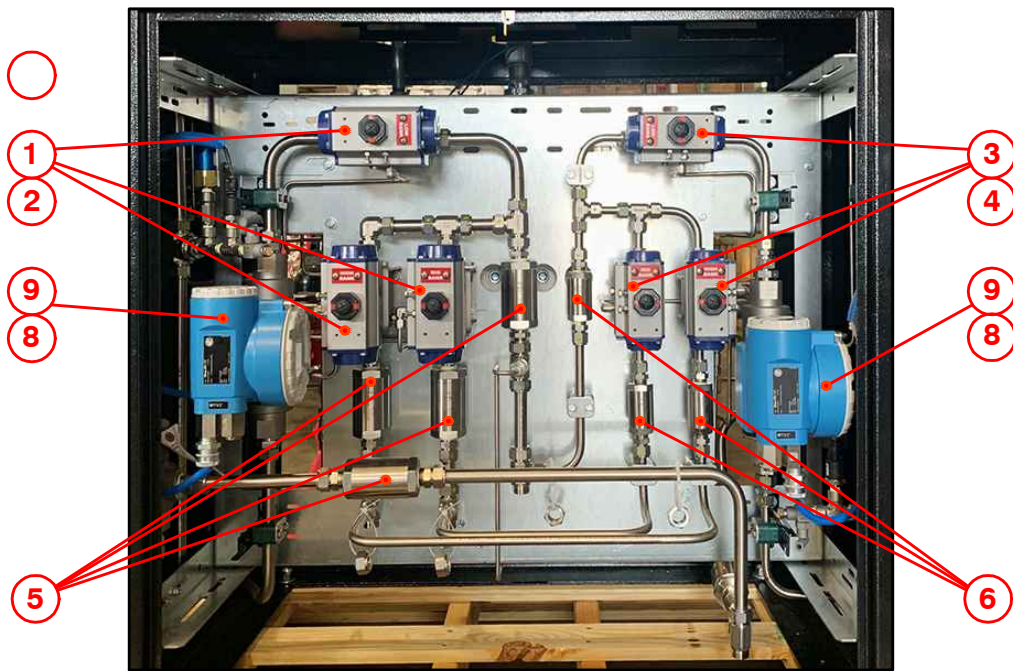

LOWER ENCLOSURE REAR

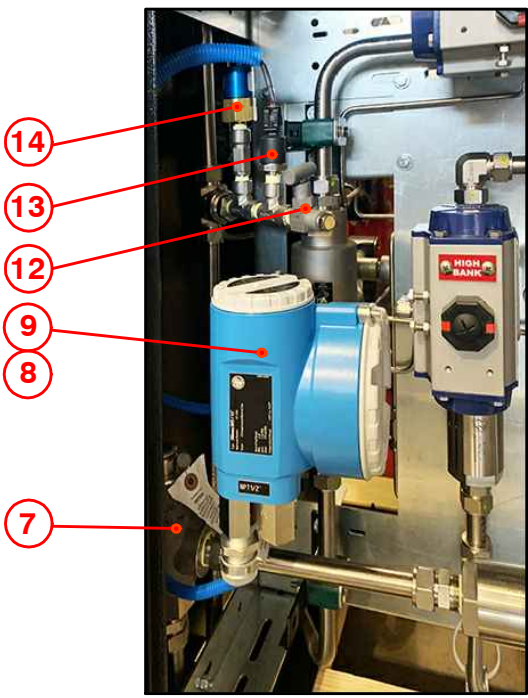


LOWER ENCLOSURE REAR LEFT

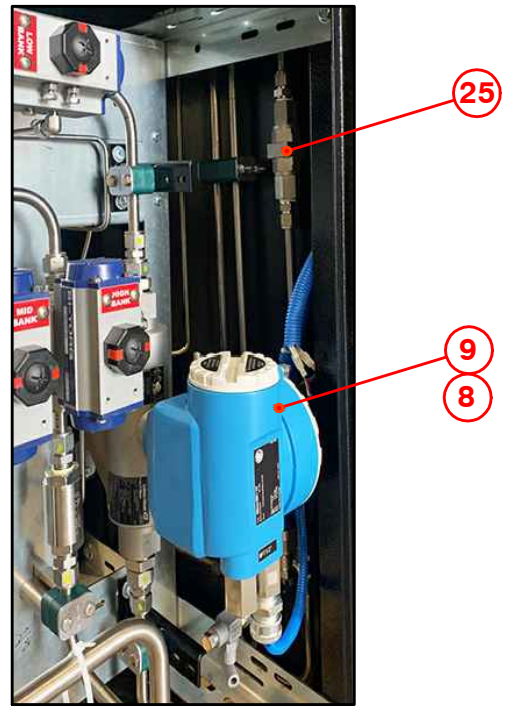


LOWER ENCLOSURE REAR RIGHT

T7203-12-8-8FF15 LOCATION DIAGRAM / MAINTENANCE BULLETIN

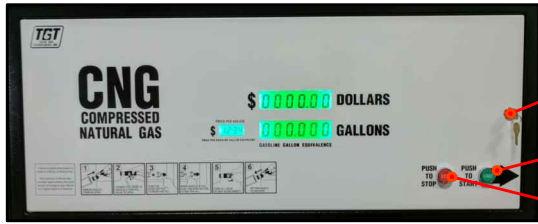

UPPER ENCLOSURE DOOR

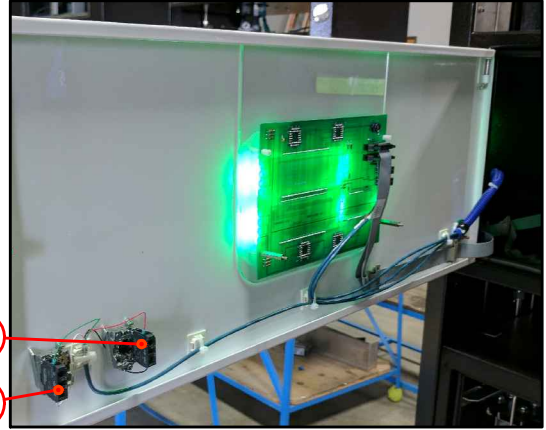

UPPER ENCLOSURE DOOR INTERIOR



MAIN BOARD



MMI



GREY BOX DISPLAY



VIBRATION SWITCH

T7203-12-8-8FF15 LOCATION DIAGRAM / MAINTENANCE BULLETIN

COMPONENTS

Item	Qty	Description	Part Number	Manufacturer
1	3	3/4" Actuator	PN63SR	Bi-Torx
2	4	3/4" Oasis Caged Ball Valve	BV706-4N6LDDN	Oasis
3	3	1/2" Actuator	PN56SR	Bi-Torx
4	3	1/2" Oasis Caged Ball Valve	BV704-4N4LDDN	Oasis
5	3	3/4" Check Valve	CV206-4NDAN	Oasis
6	3	1/2" Check Valve	CV204-4NTSN	Oasis
7	2	Mercer 4500lb Relief Valve	14-22B7112JX1	Mercer Valve
8	2	Flow Meter Endress-Hauser	CNGmass-DN15	Endress-Hauser
9	2	Transmitter	CNGmass-DN15	Endress-Hauser
10	3	5000LB TGT Gauge	50230158	TGT
11	2	Needle valve	152-MFC	NoShok
12	2	Bleed Valve	4M-BV4-SS	Parker
13	2	Pressure Transducer 0-6000lb.	G27M02RMG25000#G	Ashcroft
14	2	Mechanical Pressure Switch	CD-1C-4500/WL293	Nascon
15	6	Redhat Solenoid Valve	EF8320G184-120/60-110/50	Asco
16	2	Start Switch Electric XB4 Series	ZB4BA333	Schneider Elec.
17	2	Stop Switch Electric XB4 Series	ZB4BZ101	Schneider Elec.
18	2	Start Switch Contact Block	ZB4BA434	Schneider Elec.
19	2	Stop Switch Contact Block	ZB4BZ102	Schneider Elec.
20	4	Lock Set	C8052-C642A-14A	Comp X Inter.
21	1	Explosion Proof Box		TGT
22	1	Customer I/O Board	32003	TGT
	1	Relay	RH1B-UDC24V	IDEC
	1	Relay Socket Block	SH1B-05C	IDEC
23	1	Belgas Regulator	P39	Belgas
24	1	200# NoShok Gauge	25-911-200-PSI/KPA-BP3	NoShok
25	1	1/2" Ball Valve	8FB8LJ2-SSP	Parker

Maintenance Bulletin

1. Visual hose inspection, recommended weekly
2. Drain filter(s) at least monthly. The volume at each location will vary and filters should be drained according to need.
3. Leak check dispenser yearly. Additional leak checks should be performed after any service or repair to the dispenser.
4. Filter element replacement should take place yearly, or according to need based upon volume at each location.